AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

TEST REPORT

Client: Tremco CPG Australia Pty Ltd

12/4 Southridge street Eastern Creek NSW 2766 **Test Number** : 22-001831

Issue Date : 8/07/2022
Print Date : 8/07/2022

Sample Description Clients Ref : "Flowcoat ESD BVG"

Epoxy applied to cement sheet


Colour: Grey

End Use: Floor coating

Nominal Composition: Electro static dissipative epoxy coating

Nominal Mass per Unit Area/Density: 400g/m2

Nominal Thickness: 0.35-0.4mm

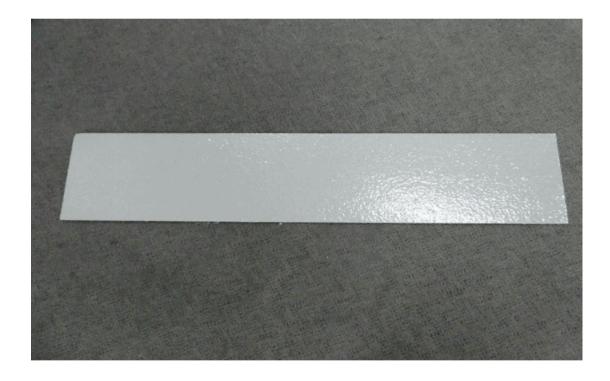

272387 58386 Page 1 of 2

Australian Wool Testing Authority Ltd Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



MICHAEL A. JACKSON B.Sc.(Hons)

Fiona McDonald

APPROVED SIGNATORY



Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

TEST REPORT

Client: Tremco CPG Australia Pty Ltd

12/4 Southridge street
Eastern Creek NSW 2766

Test Number : 22-001831 **Issue Date** : 8/07/2022

Print Date : 8/07/2022

AS ISO 9239.1-2003

Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a Radiant Heat Source

Date of Sample Arrival

08-07-2022

23-05-2022

Date Tested

CHF Value 3 Mean Non Directional ≥11.0 10.8 ≥11.0 kW/m² Smoke Value 2 1 3 Mean Non Directional 23 34 27 %.min

Observations:

Melting Yes

Each specimen was clamped to a substrate of 6mm thick fibre reinforced cement board prior to testing.

HF30 not reported as flame out time occurred before 30 minutes.

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2010 at a temperature of 23±2°C and relative humidity of 50±5% for a minimum of 48 hours prior to testing.

Results in accordance with section 8.4 have not been included in the report. They are available upon request.

272387 58386 Page 2 of 2

Australian Wool Testing Authority Ltd Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



MICHAEL A. JACKSON B.Sc.(Hons)

Fiona McDonald

APPROVED SIGNATORY